



Main return air box-FBC 5th Edition Residential M1601.4.1  
FBC 5th Edition-Mechanical 603.9



Main return air box-FBC 5th Edition Residential M1601.4.1  
FBC 5th Edition-Mechanical 603.9




Main return air box-FBC 5th Edition Residential M1601.4.1  
FBC 5th Edition-Mechanical 603.9



Master supply air-FBC 5th Edition Residential M1601.4.1  
FBC 5th Edition-Mechanical 603.9



Drain line not insulated or supported  
FBC 5th Edition Mechanical 307.2.5

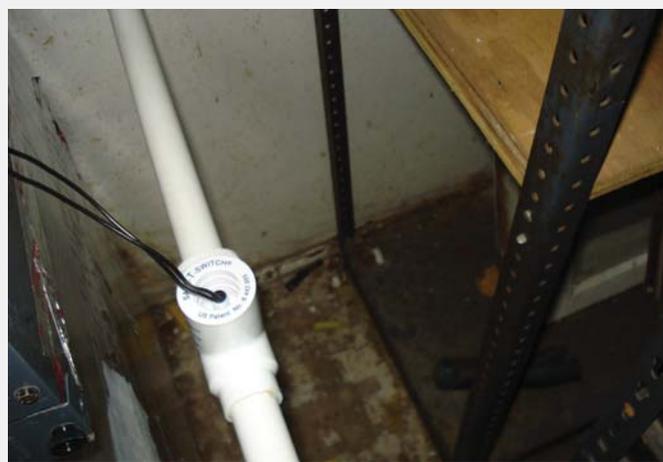

Drain line not insulated or supported  
FBC 5th Edition Mechanical 307.2.5


Stop Work



Supply air plenum at air handler  
FBC 5th Edition Mechanical 603.9



New air supply  
FBC 5th Edition Mechanical 603.9

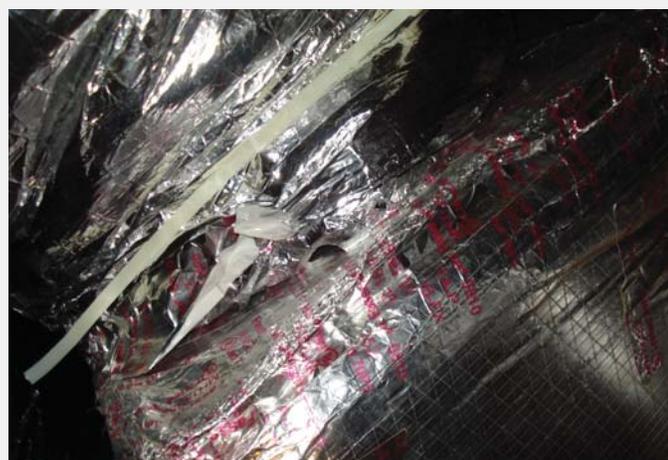

Flex duct not installed properly  
FBC 5th Edition Mechanical 603.9/Residential M1601.4.2



Flex duct not installed properly  
FBC 5th Edition Mechanical 603.9/Residential M1601.4.2



Flex duct not supported properly  
FBC 5th Edition Mechanical 603.10




Flex duct not supported properly  
FBC 5th Edition Mechanical 603.10

Stop Work



Return air not sealed properly  
FBC 5th Edition Mechanical 603.9

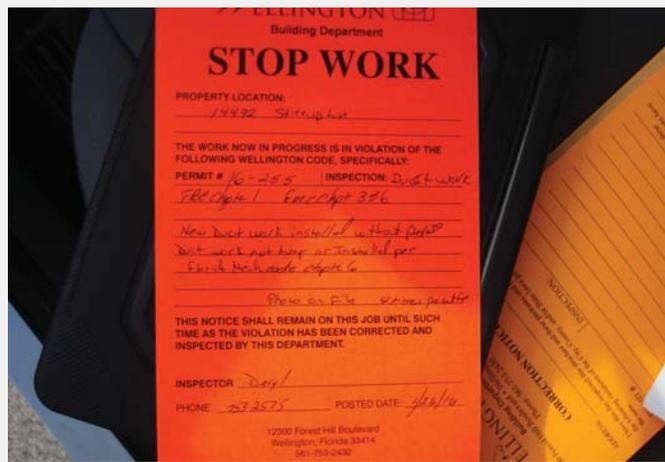

Stop work order  
FBC 5th Edition Building 115.1

