


V.O.W. CONSTRUCTION STANDARDS & DETAILS

TYPICAL LIFT STATION (SECTION)

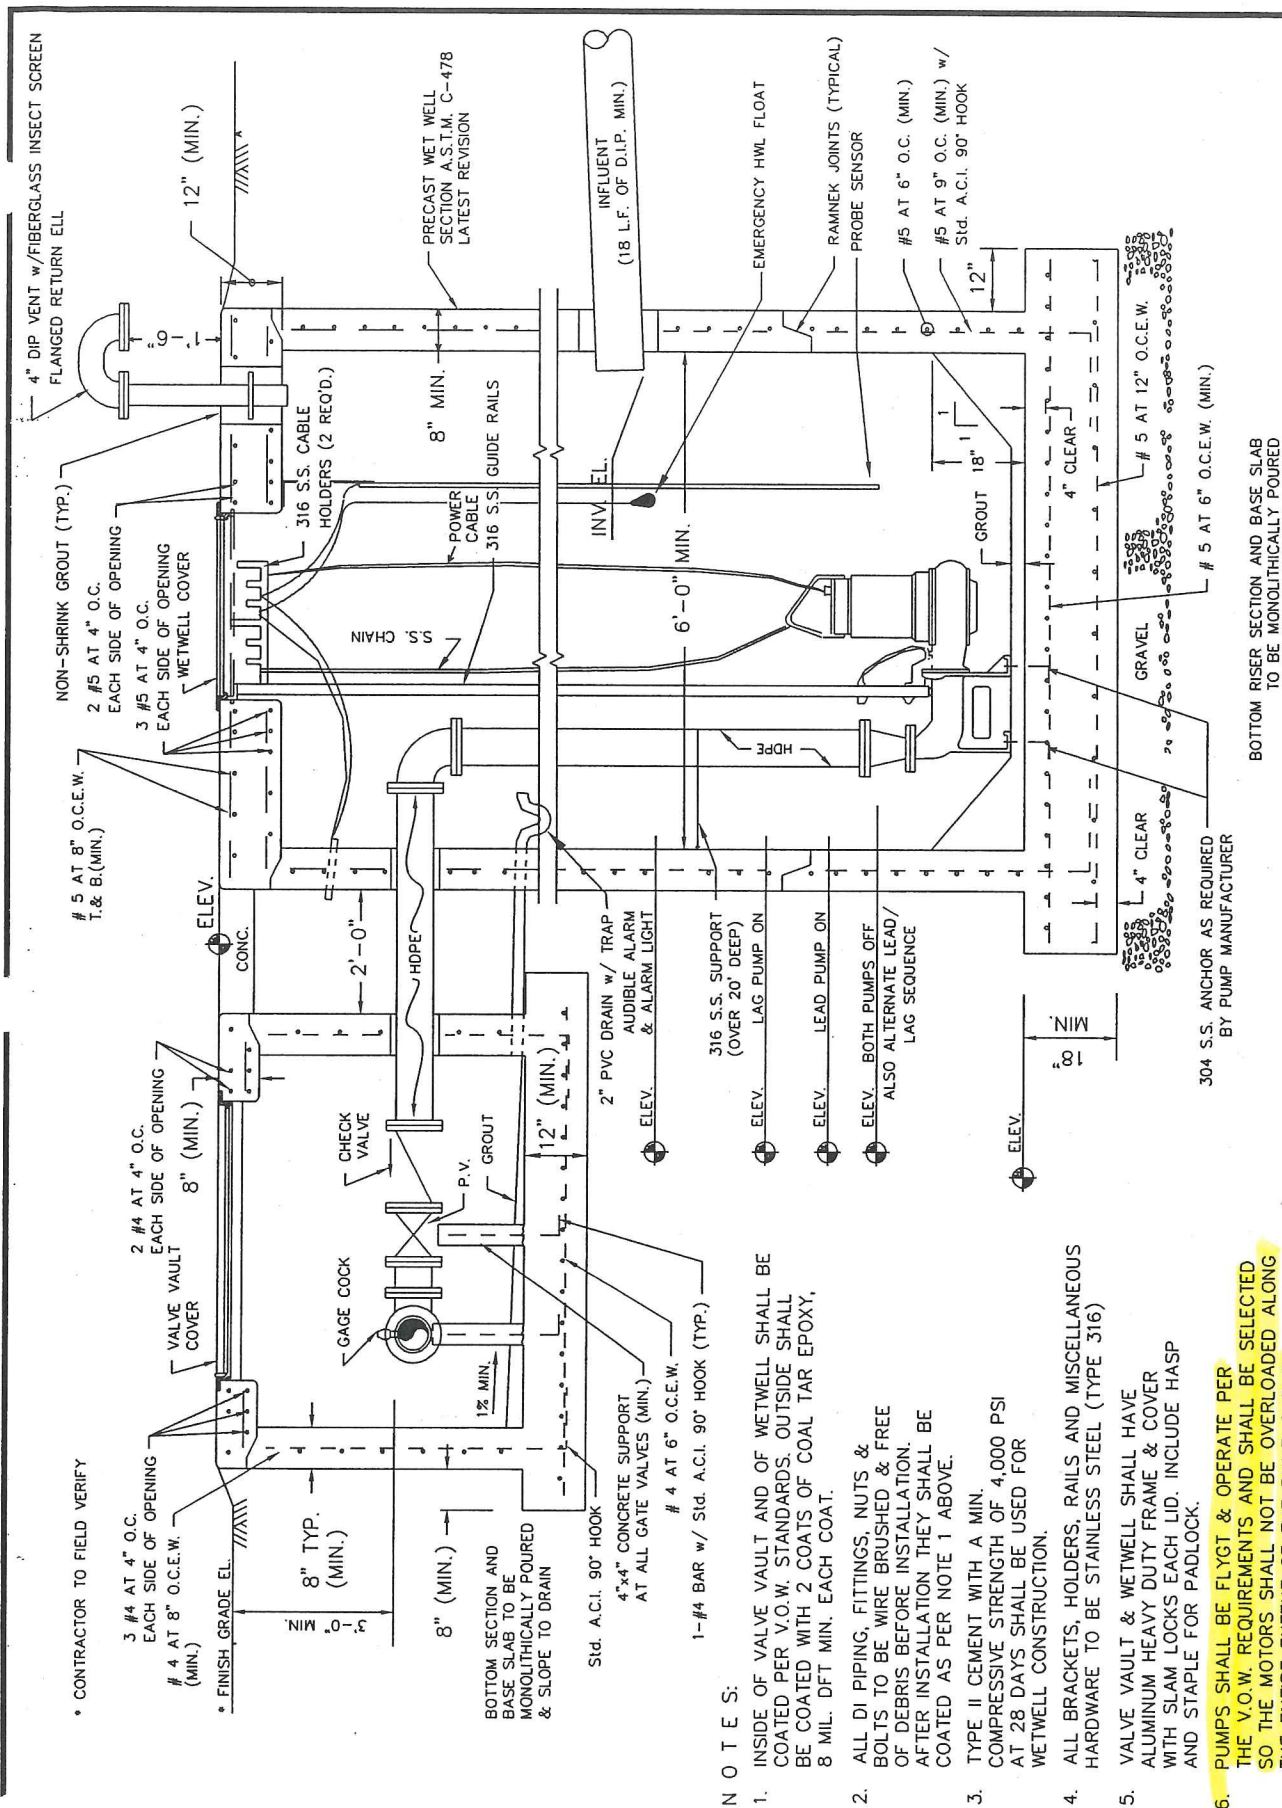

10. ALL PIPING FROM CHECK VALVES IN VALVE VAULT TO PUMP SUPPORT SHOE IS TO BE HDPE SDRII.

9. WET WELLS SHALL BE FITTED WITH A PERMANENTLY INSTALLED FALL THROUGH PREVENTION NET SYSTEM THAT IS EASILY RETRACTABLE FOR ACCESS TO THE OPENING BELOW. THIS SYSTEM SHALL BE A HATCH SAFETY NET OR APPROVED EQUAL.